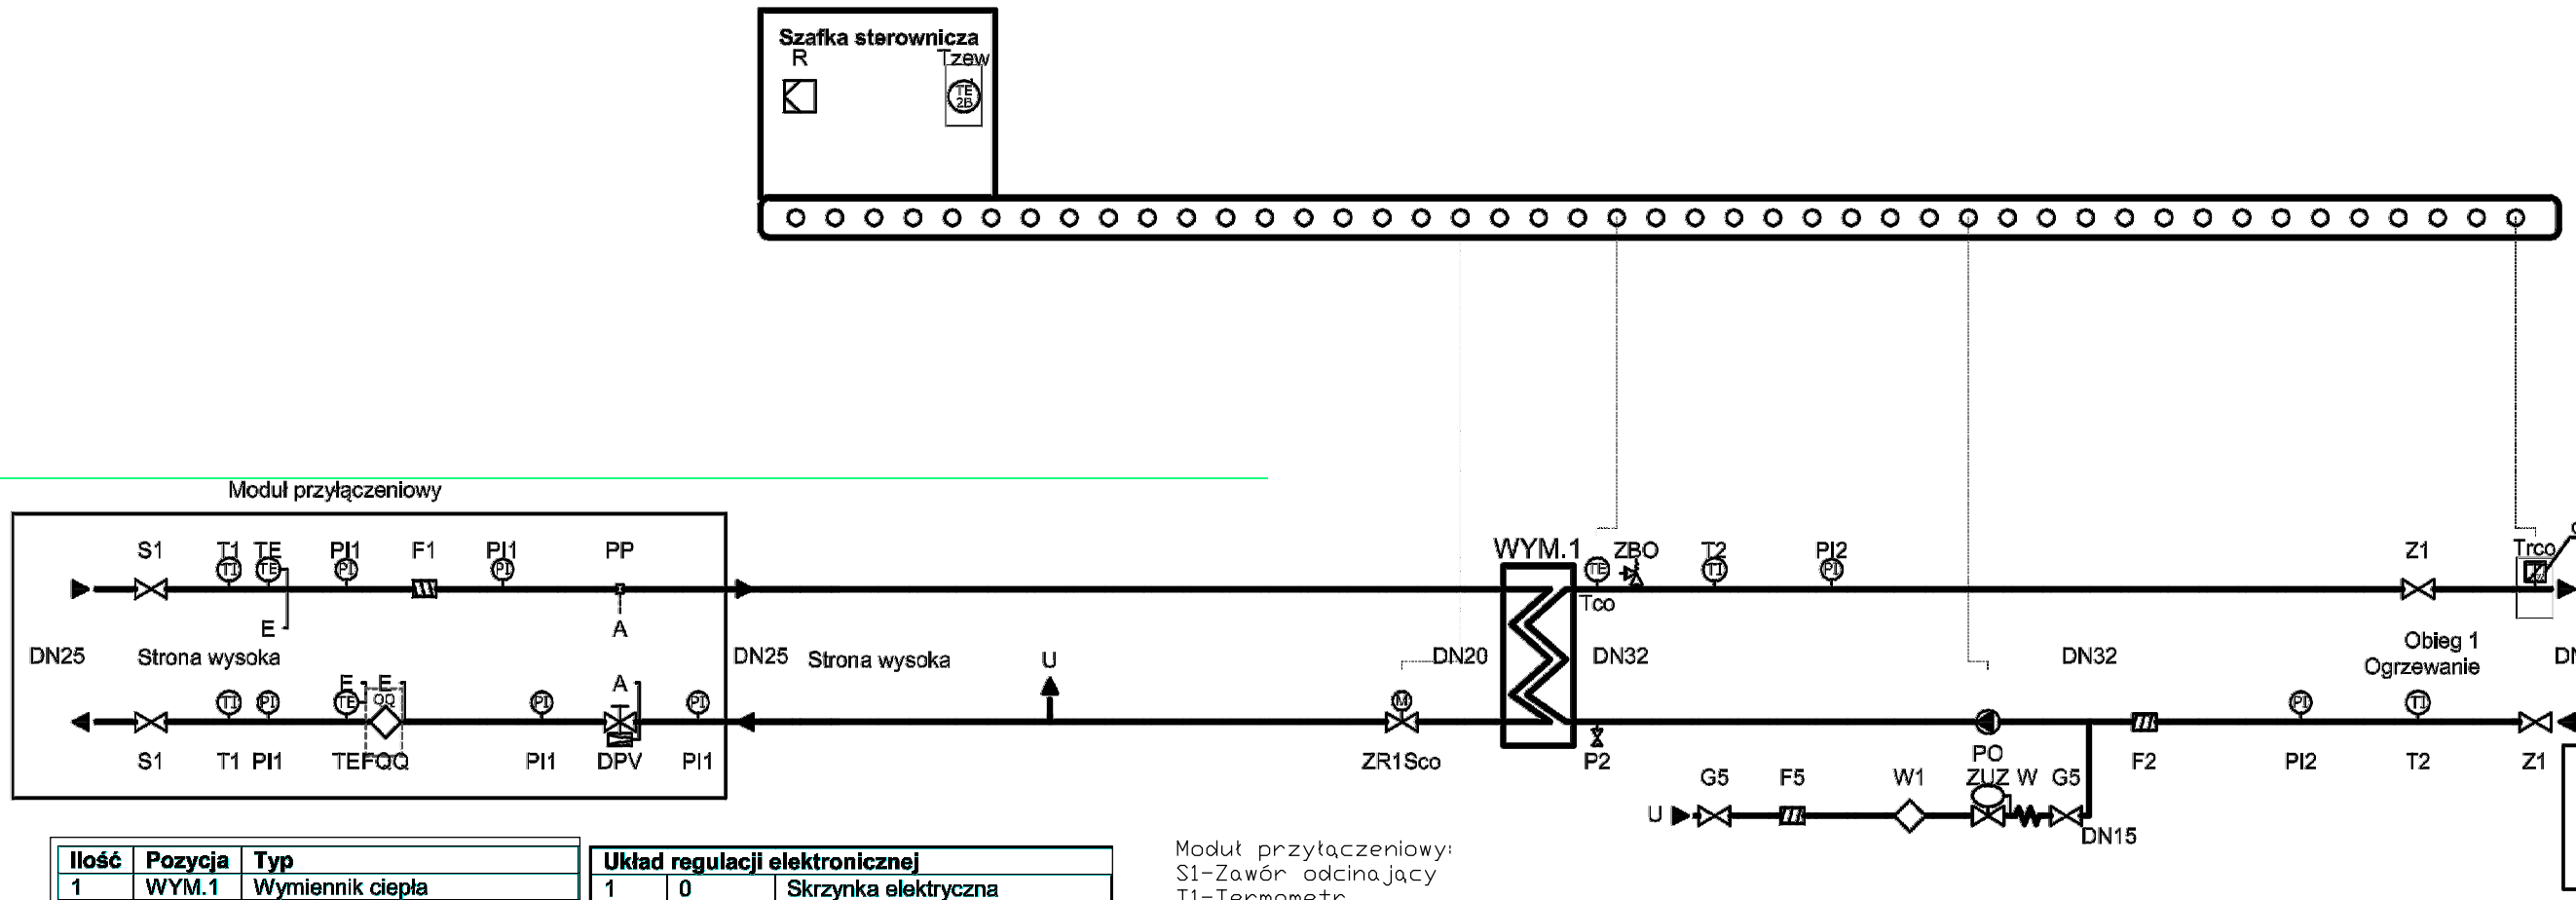

Moduł przyłączeniowy:
S1-Zawór odcinający
T1-Termometr
PI1-Manometr
F2-Filtr kołnierzowy
FQQ1-Licznik ciepła
DPV1-Regulator różnicy ciśnień

Ilość	Pozycja	Typ
1	WYM.1	Wymiennik ciepła
Wysoki parametr		
1	ZR1Sco	Siłownik elektryczny dla zaworu regulacyjnego
1	ZR1Sco	Zawór regulacyjny
WYM.1 niskie parametry		
1	F2	Filtr
1	P2	Zawór spustowy
1	PO	Pompa
2	T2	Termometr
2	Z1	Zawór odcinający
2	PI2	Kurek manometryczny
2	PI2	Manometr
1	Tco	Czujnik kieszeniowy
1	ZBO	Zawór bezpieczeństwa
1	Trco	Termostat TR/STW

Układ regulacji elektronicznej		
1	0	Skrzynka elektryczna
1	R	Klucz aplikacji ECL
1	R	Regulator pogodowy
1	Tzew	Czujnik temp. zewnętrznej
Układ 1 stabilizująco-uzupełniający		
1	W	Przewód (uzupełnianie zładu)
1	F5	Filtr
2	G5	Zawór odcinający
1	W1	Licznik przepływu
1	ZUZ	Zawór uzupełnienia zładu
DSA WALL - zestaw REFLEX NG 50/6 bar		
1	NW	Naczynie wzbiorcze
1	SU	Zawór rozprężny
1	PI2	Kurek manometryczny
1	PI2	Manometr

			Projection	Scale	Size A4	Material
						Danfoss Standard 500B0598
-						Designation 11781.0
Mrk.	Approval/Rev	Date				40176 Katowice ul Kochanowskiego 12
Replace						DSA Wall 1F Konstytucji 3 Maj
Design						
Approval					&company_name	
Confidential: Property of Danfoss A/S, Nordborg, Denmark. Not to be handed over to, copied or used by third party. Two- or three dimensional reproduction of contents to be authorized by Danfoss A/S.						No.
						Sheet 1:1